

# CR2820-1054 TIME RELAY

## INSTRUCTIONS

# CR2820-1054 TIME RELAY

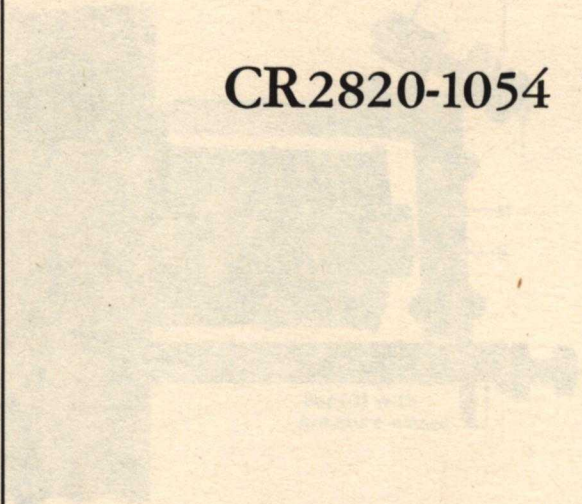


Fig. 1. CR2820-1054 Relay

CR2820-1054 Time Relay with an adjustable pull-out of contact's low drop-out voltage or contact closure at 1/4 voltage is not available. The relay may be energized from an AC source through a transformer rectifier.

If the relay will be energized from an AC source, the contact's low drop-out voltage in the relay will be 1/4 of the AC supply. As illustrated in Fig. 2, for a contact voltage of 115V, the contact will close at time (1), time in the relay will be delayed to (2), a further delay will be necessary before the contact is closed. The time delay is increased to (3) and the time delay in the magnetic circuit will be the same as the delay before the contact is closed. The time delay is substantially independent of the actual voltage in the circuit.

When used in the CR2820 type of relay with other accessories, the relay will have a staff and distinct features as shown below.

TO DEMONSTRATE TIME CONTROL OF AN AC CIRCUIT (CR2820-1054)

Fig. 2 shows the application of CR2820-1054 relay to control the voltage in the AC circuit. The relay is energized by the AC supply and the contact is closed at time (1). The contact is delayed to (2) and a further delay is necessary before the contact is closed.

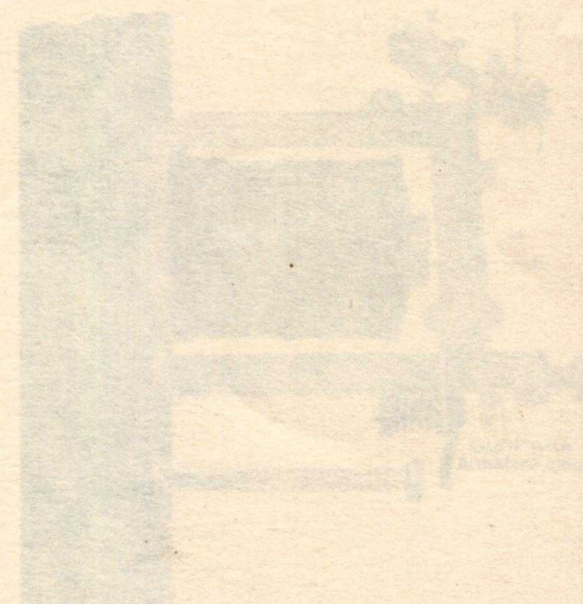


Fig. 2. CR2820-1054 Relay

**GENERAL  ELECTRIC**  
 SCHENECTADY, N. Y.

# CR2820-1054 TIME RELAY

The CR2820-1054 relay is designed primarily as a d-c instantaneous pick-up, time delay drop-out relay. It may also be utilized as a d-c volt-

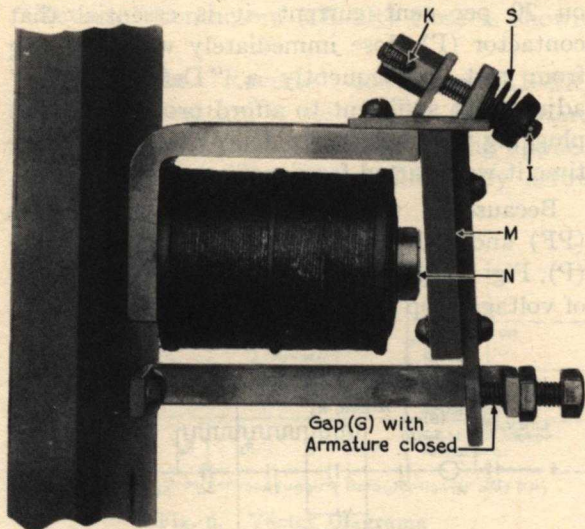


Fig. 1. CR2820-1054B Relay

age or current relay with an adjustable pick-up and relatively low drop-out voltage or current. If a source of d-c voltage is not available, the relay may be energized from an a-c source through a copper-oxide rectifier.

If the relay coil is short-circuited when energized, the current in the coil and the flux in the magnetic circuit will die out slowly. As indicated in Fig. 3, for armature spring force (P1), the armature will release at time (T1), while if the spring force is decreased to (P2), a further decrease in flux is necessary before the armature releases, and the time delay is increased to (T2). Since the flux density in the magnetic circuit is above the point of saturation when the armature is closed, the time adjustment is substantially independent of the usual variation in line voltage.

For certain applications it is more convenient to initiate the time-delay drop-out of the relay by opening the coil circuit instead of short-circuiting the coil as described above. For such

applications coils are supplied which have a cylindrical copper jacket around the core of the relay. When the coil is de-energized, the decay of flux induces in the copper jacket a current which dies down relatively slowly, and the resulting slow decay of flux gives a time-delay drop-out in the same manner as described in the previous paragraph.

When applied to the usual type of d-c steel mill or crane control equipment, this relay serves three separate and distinct functions as described below.

## (1) DEFINITE-TIME CONTROL OF ACCELERATION (CR2820-1054B)

Fig. 4 shows this application of this relay. It will be noted that the coils of the accelerating relays (1A) and (2A) are connected across divisions (R1-R2) and (R1-R3) respectively of the resistor.

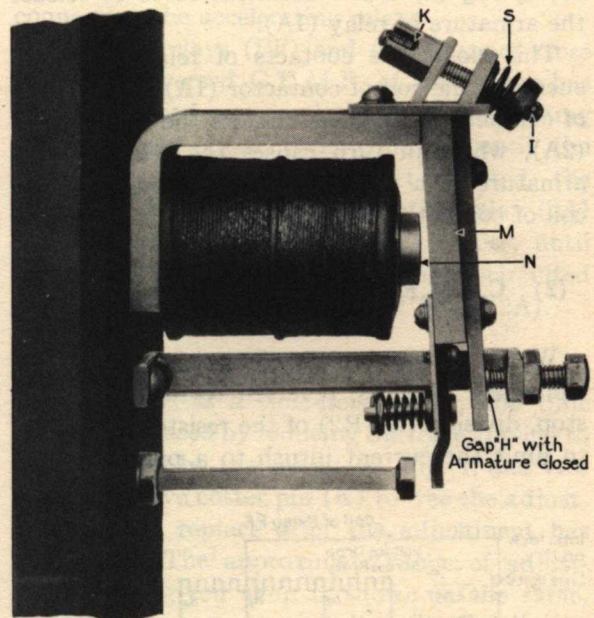


Fig. 2. CR2820-1054A Relay

When the forward contactors (1F-2F) close and establish the armature circuit through the resistor, the voltage drop across division (R1-R2)

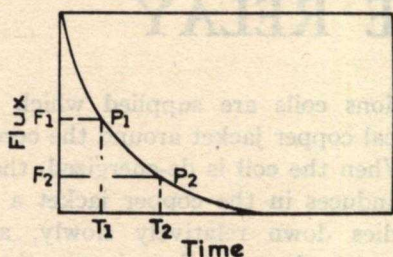


Fig. 3. Flux-time Curve

is applied to the coil of relay (1A), and the voltage drop across divisions (R1-R2), plus (R2-R3) is applied to the coil of relay (2A). The respective relay armatures close, opening the contacts of these relays.

Assuming contactor (P) to close, as explained later in Section 2, its tips will short-circuit resistor division (R1-R2), also the coil of relay (1A), and the magnetic energy stored in the relay (1A), due to the flux produced in the heavy iron frame, tends to dissipate itself as previously explained, until a density is reached such that the spring (S) exerts sufficient force to release the armature of relay (1A).

This closes the contacts of relay (1A) and energizes the coil of contactor (1A). The closing of contactor (1A) short-circuits the coil of relay (2A), which in turn causes the release of its armature in a definite time and energizes the coil of contactor (2A).

**(2) C.E.M.F. CONTROL OF PLUGGING (CR2820-1054A)**

When an equipment is subject to being "plugged," that is, reversed to insure a quick stop, division (R1-R2) of the resistor is adapted to limit the current inrush to a predetermined

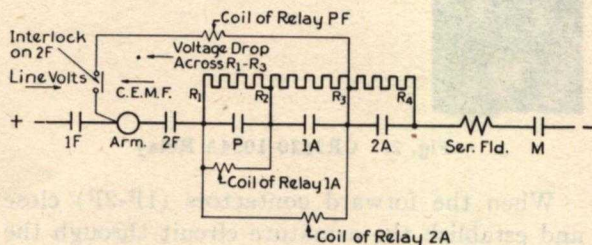


Fig. 4. Elementary Connection Diagram

safe value (approximately 140 per cent). The resistance of division (R1-R2) is such that in conjunction with divisions (R2-R3) and (R3-R4), the current inrush when starting from rest will not exceed approximately 70 per cent of the motor rating. Since the motor may not start on 70 per cent current, it is essential that contactor (P) close immediately when starting from rest, consequently a "Definite Time" adjustment sufficient to afford protection when plugging would seriously delay the motor every time it was started from rest.

Because of this the normally open relays (PF) and (PR) controlling plugging contactor (P), Fig. 4 and 5, are actuated by a combination of voltage drop across (R1-R2) and C.E.M.F. to

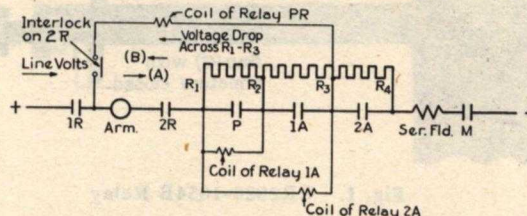


Fig. 5. Elementary Connection Diagram

afford protection when plugging and to give instantaneous closing when starting.

Referring to Fig. 4, the coil of relay (PF) is connected across the armature, the plugging division (R1-R2), and the first accelerating division (R2-R3) of the resistor, this circuit being established through the interlock only when the "Forward" contactors (1F-2F), are closed. The coil of relay (PR) is connected in a similar manner except that its circuit is established through an interlock only when the "Reverse" contactors (1R-2R) are closed.

Assuming contactors (1F-2F) and interlock to be closed, Fig. 4, the voltage drop across the resistor and the motor C.E.M.F. may be imagined as opposing the applied voltage as indicated by the arrows. The voltage drop across the resistor will produce instantaneous pickup of the relay, which will be held closed by the C.E.M.F. and voltage drop across resistor division (R2-R3) after division (R1-R2) is

short-circuited by contactor (P). This is also shown by the vector diagrams (A) and (B) in Fig. 6.

If the motor is now accelerated to full speed in the "Forward" direction and then plugged, the condition existing immediately after the "Reverse" contactors (1R-2R) close is shown, Fig. 5.

Closing the "Reverse" contactors (1R-2R) while the armature is rotating in the forward direction results in the C.E.M.F. being applied in the opposite direction, as shown by arrow

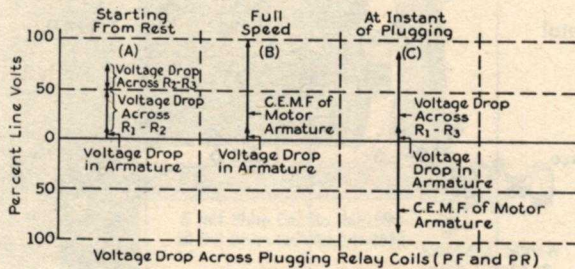


Fig. 6. Vector Diagrams

(A) in Fig. 5. This is also shown in the vector diagram (C) in Fig. 6.

At the instant of plugging, therefore, the voltage across the coil of relay (PR) is practically zero, and it remains open.

During the time of deceleration, the motor acts as a generator, and the C.E.M.F. is opposite in effect to the voltage drop across (R1-R2). The C.E.M.F. falls off to zero as the motor comes to rest, while the voltage across (R1-R2) decreases from the maximum shown at instant of plugging to a similar value to that at starting from rest (vector diagram (A), Fig. 6). The relay (PR) will therefore pick up as the motor comes to rest (approximately) and will then energize the plugging contactor (P), and the acceleration is the same as previously described.

The CR2820-1054A relay, when used for plugging, should be adjusted to pick up on the voltage drop across the plugging resistor (R1-R2) when the motor is started from rest. It must not be set too low since, on plugging, the relay will close too quickly (producing an excessive current peak) while the motor is running at a

considerable speed. This adjustment should be made entirely with spring (S), Fig. 2.

### (3) SEQUENCE INTERLOCKING

Because of the relation that must exist between resistor divisions (R1-R2), (R2-R3), and (R3-R4) to insure uniform accelerating peaks, that is, each succeeding division being proportionately smaller, it is necessary that the divisions be short-circuited in this order. After the line contactors close, contactors (P), (1A) and (2A) must close in sequence. This definite sequence of operation is ordinarily secured by means of interlocks on the contactors, each contactor having an interlock which must close before the coil of the succeeding contactor may be energized. Sometimes this interlock is part of a series "current limit" attachment providing current limit control and sequence.

Referring to Fig. 4 and 5, it will be noted that contactors (P), (1A) and (2A) are without any form of interlock and that the sequence of operation is assured through the method of connecting the accelerating relays.

Plugging relays (PF) and (PR) cannot close until the reversed C.E.M.F. of the motor has almost reached zero, and the time accelerating relays cannot close their contacts until the preceding contactor has short-circuited the relay coil. For instance, accelerating relay (2A) will not permit contactor (2A) to close, until contactor (1A) has closed and short-circuited division (R2-R3) and the coil of relay (2A).

### ADJUSTMENTS

When used as a time-delay relay, the time may be increased by reducing the force applied to the armature by the spring (S), Fig. 1, and vice versa. Remove cotter pin (K) to free the adjusting nut and replace after the adjustment has been made. The approximate range of adjustment for a given shim is shown in the table, Fig. 7. The armature spring force must be strong enough to hold the armature positively against the back stop screw, but must not be increased to a value where the armature will fail to close if the coil is energized when at its maximum operating temperature.

GEH-85 E CR2820-1054 Time Relay

| Qty | Shim Cat. No. | Effective Thickness in Inches | Identification |      |          | Approximate Time Range—Seconds † |             |                                 |
|-----|---------------|-------------------------------|----------------|------|----------|----------------------------------|-------------|---------------------------------|
|     |               |                               | New            | Old  | Material | For Coils with Copper Jacket     |             | For Coils Without Copper Jacket |
|     |               |                               |                |      |          | CR2820-1054B                     | Other Forms |                                 |
| 1   | 5354688       | .0005                         |                |      | bimetal  |                                  |             |                                 |
| 1   | 5155942       | .001                          |                |      | bimetal  |                                  |             | 1.5-2.5                         |
| 1   | 5354689       | .0015                         |                |      | bimetal  | 1.3-2                            | 1.5-2       | 1.3-1.9                         |
| 1   | 2451597       | .005                          |                | same | bronze   | 0.9-1.6                          | 1.3-1.6     | 0.8-1.3                         |
| 1   | 8616834       | .007                          |                | same | bronze   | 0.75-1.4                         | 1-1.4       | 0.65-1.15                       |
| 1   | 2450533       | .010*                         |                | same | bronze   | 0.6-1.25                         | 0.75-1.25   | 0.5-1                           |
| 1   | 8047765       | .015                          |                |      | bronze   | 0.4-0.8                          | 0.5-0.8     | 0.4-0.7                         |
| 1   | 2439592       | .020                          |                | same | bronze   | 0.35-0.7                         | 0.4-0.6     | 0.25-0.45                       |
| 2   | 8047765       | .030φ                         |                |      | bronze   | 0.2-0.35                         | 0.25-0.35   | 0.15-0.25                       |
| 1   | 1453458       | .060                          |                | same | bronze   |                                  |             |                                 |

\*Standard shim for steel-mill service.

†Maximum time is reduced about 30 per cent for relays having four double-break contacts, or two finger-type contacts and one or more double-break contacts.

φTwo shims each .015 inch thick

Fig. 7. Shim Data

If the desired time cannot be secured by adjustment of the armature spring pressure, it may be necessary to utilize a shim of different thickness. For the frequent operation encountered in steel-mill service, the use of shims thinner than 0.010 inch is not recommended. The 0.010-inch thick shim is ordinarily supplied with the

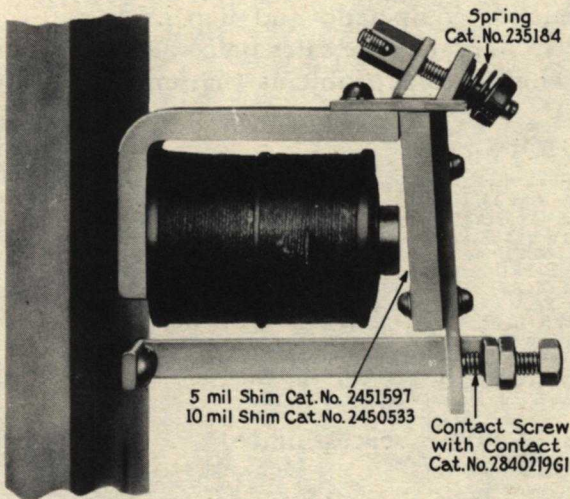


Fig. 8. Renewal Parts for CR2820-1054B Relay

and make sure that brass screws (not steel screws) are used to fasten the shim in place on the armature. The effective air gap in the magnetic circuit when bimetallic shims are used is so small that such factors as accumulation of dirt particles, or mechanical wear will tend to affect the timing to a greater extent than when thicker shims are used.

In addition to affecting the amount of time delay, the shim prevents residual magnetism in the magnetic circuit from holding the armature closed indefinitely. A shim must always be used. While it may appear possible in some cases to secure a relatively long time delay by omitting the shim, the time is likely to be erratic, and it is probable that after a few operations the residual magnetism will prevent the armature from opening at all.

For the CR2820-1054B relay, the armature

relay unless a shim of different thickness is required to secure a longer or shorter time for certain applications.

If bimetallic shims are used, see that the bronze side of the shim is next to the armature,

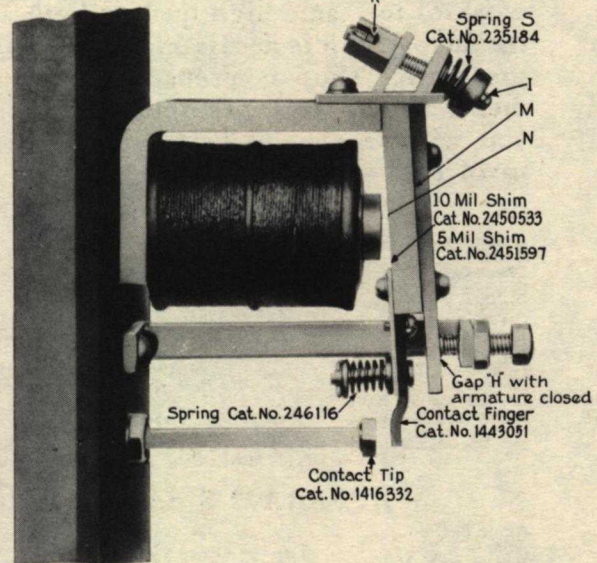


Fig. 9. Renewal Parts for CR2820-1054A Relay

back stop screw is normally adjusted at the factory to give a gap of  $\frac{1}{16}$  inch at (G), Fig. 1, with the armature closed, and it should not ordinarily be necessary to change this adjustment. For the CR2820-1054A relay, and for other forms without magnetic blowouts, gap (H), Fig. 2, should be  $\frac{1}{4}$  inch. For CR2820-1054 relays with magnetic blowouts and arc chutes, this gap is usually  $\frac{5}{16}$  inch.

Armature (M) may be easily removed without disturbing the calibration by removing crotter pin (I), while to change the calibration it is necessary to remove crotter pin (K).

### RENEWAL PARTS

When ordering parts other than those shown in Fig. 8 or 9, give the complete nameplate rating of the relay and describe the part in detail.

## WHEN SERVICE IS REQUIRED

**T**HE facilities of our engineering divisions and factories are available to purchasers of G-E apparatus through G-E service shops and sales offices, a list of which is given below.

When it is necessary to renovate, repair, or change apparatus to meet a new operating condition or a new application, the facilities of the nearest G-E service shop are at your disposal. Each of them is equipped to turn out work of the same high quality, both as to workmanship and materials, as at the factory. If it is necessary that the work be done on the customer's premises, the service shop is prepared to send trained, competent, and dependable men who will do it promptly and efficiently. Similarly, the sales office nearest you will be glad to help you with any engineering problems that may be involved.

### SERVICE SHOPS

|                                |                                 |                                  |                             |
|--------------------------------|---------------------------------|----------------------------------|-----------------------------|
| Atlanta, Ga. . . . .           | 496 Glenn Street, Southwest     | Minneapolis 1, Minn. . . . .     | 410 Third Avenue, North     |
| Buffalo 11, N. Y. . . . .      | 318 Urban Street                | New York 14, N. Y. . . . .       | 416 West Thirteenth Street  |
| Charleston 28, W. Va. . . . .  | 306 MacCorkle Avenue, Southeast | Philadelphia 23, Pa. . . . .     | 429 North Seventh Street    |
| Chicago 7, Ill. . . . .        | 849 South Clinton Street        | Pittsburgh 6, Pa. . . . .        | 6519 Penn Avenue            |
| Cincinnati 2, Ohio . . . . .   | 215 West Third Street           | St. Louis 1, Mo. . . . .         | 1110 Delmar Boulevard       |
| Cleveland 4, Ohio . . . . .    | 4966 Woodland Avenue            | Salt Lake City 9, Utah . . . . . | 141 South Third West Street |
| Dallas 2, Texas . . . . .      | 1801 North Lamar Street         | San Diego, Calif. . . . .        | 2045 Tetterer Boulevard     |
| Detroit 2, Mich. . . . .       | 5950 Third Avenue               | San Francisco 7, Calif. . . . .  | 361 Bryant Street           |
| Houston 1, Texas . . . . .     | 1312 Live Oak Street            | Seattle 4, Wash. . . . .         | 1508 Fourth Avenue, South   |
| Kansas City 8, Mo. . . . .     | 819 East Nineteenth Street      | West Lynn 3, Mass. . . . .       | 920 Western Avenue          |
| Los Angeles 54, Calif. . . . . | 733 Banning Street              | Youngstown 3, Ohio . . . . .     | 121 East Boardman Street    |
| Milwaukee 3, Wis. . . . .      | 940 West St. Paul Avenue        |                                  |                             |

Special service divisions are also maintained at the following Works of the Company: Erie, Pa.; Ft. Wayne, Ind.; Pittsfield, Mass.; Schenectady, N. Y.; and West Lynn, Mass. (West Lynn Works)

### APPARATUS SALES OFFICES (Address nearest office)

|                                |                                 |                                  |                                 |
|--------------------------------|---------------------------------|----------------------------------|---------------------------------|
| Akron 8, Ohio . . . . .        | 335 South Main Street           | Milwaukee 3, Wis. . . . .        | 940 West St. Paul Avenue        |
| Atlanta 3, Ga. . . . .         | 187 Spring Street, Northwest    | Minneapolis 2, Minn. . . . .     | 12 South Sixth Street           |
| Baltimore 1, Md. . . . .       | 39 West Lexington Street        | Nashville 3, Tenn. . . . .       | 234 Third Avenue, North         |
| Beaumont, Texas . . . . .      | 398 Pearl Street                | Newark 2, N. J. . . . .          | 744 Broad Street                |
| Birmingham 2, Ala. . . . .     | 19 Chenango Street              | New Haven 6, Conn. . . . .       | 129 Church Street               |
| Birmingham 2, Ala. . . . .     | 600 North Eighteenth Street     | New Orleans 12, La. . . . .      | 837 Gravier Street              |
| Bluefield, W. Va. . . . .      | Appalachian Building            | New York 22, N. Y. . . . .       | 570 Lexington Avenue            |
| Boston 1, Mass. . . . .        | 140 Federal Street              | Niagara Falls, N. Y. . . . .     | 253 Second Street               |
| Buffalo 2, N. Y. . . . .       | 1 West Genesee Street           | Norfolk 1, Va. . . . .           | 267 Bank Street                 |
| Butte, Mont. . . . .           | 20 West Granite Street          | Oakland 12, Calif. . . . .       | 409 Thirteenth Street           |
| Canton 1, Ohio . . . . .       | 700 Tuscarawas Street, West     | Oklahoma City 2, Okla. . . . .   | 119 North Robinson Street       |
| Charleston 3, S. C. . . . .    | 18 Broad Street                 | Omaha 2, Nebr. . . . .           | 409 South Seventeenth Street    |
| Charleston 28, W. Va. . . . .  | 306 MacCorkle Avenue, Southeast | Philadelphia 2, Pa. . . . .      | 1405 Locust Street              |
| Charlotte 1, N. C. . . . .     | 200 South Tryon Street          | Phoenix, Ariz. . . . .           | 435 West Madison Street         |
| Chattanooga 2, Tenn. . . . .   | 832 Georgia Avenue              | Pittsburgh 22, Pa. . . . .       | 535 Smithfield Street           |
| Chicago 7, Ill. . . . .        | 840 South Canal Street          | Portland 7, Ore. . . . .         | 920 Southwest Sixth Avenue      |
| Cincinnati 2, Ohio . . . . .   | 215 West Third Street           | Providence 3, R. I. . . . .      | 111 Westminster Street          |
| Cleveland 4, Ohio . . . . .    | 4966 Woodland Avenue            | Reading, Pa. . . . .             | 31 North Sixth Street           |
| Columbia 23, S. C. . . . .     | 1225 Washington Street          | Richmond 17, Va. . . . .         | 700 East Franklin Street        |
| Columbus 15, Ohio . . . . .    | 40 South Third Street           | Roanoke 11, Va. . . . .          | 202 South Jefferson Street      |
| Dallas 2, Texas . . . . .      | 1801 North Lamar Street         | Rochester 4, N. Y. . . . .       | 89 East Avenue                  |
| Davenport, Iowa . . . . .      | 511 Pershing Avenue             | St. Louis 2, Mo. . . . .         | 112 North Fourth Street         |
| Dayton 2, Ohio . . . . .       | 25 North Main Street            | Salt Lake City 9, Utah . . . . . | 200 South Main Street           |
| Denver 2, Colo. . . . .        | 650 Seventeenth Street          | San Antonio 5, Texas . . . . .   | 310 South St. Mary's Street     |
| Detroit 2, Mich. . . . .       | 700 Antoinette Street           | San Diego 1, Calif. . . . .      | 861 Sixth Avenue                |
| Duluth 2, Minn. . . . .        | 14 West Superior Street         | San Francisco 4, Calif. . . . .  | 235 Montgomery Street           |
| El Paso, Texas . . . . .       | 109 North Oregon Street         | Schenectady 5, N. Y. . . . .     | 202 State Street                |
| Erie 2, Pa. . . . .            | 10 East Twelfth Street          | Seattle 11, Wash. . . . .        | 710 Second Avenue               |
| Evansville 19, Ind. . . . .    | 123 Northwest Fourth Street     | Shreveport, La. . . . .          | 206 Market Street               |
| Fairmont, W. Va. . . . .       | 511 Jacobs Building             | Spokane 8, Wash. . . . .         | 421 Riverside Avenue            |
| Fort Wayne 2, Ind. . . . .     | 127 West Berry Street           | Springfield, Ill. . . . .        | 607 East Adams Street           |
| Fort Worth 2, Texas . . . . .  | 408 West Seventh Street         | Springfield 3, Mass. . . . .     | 1387 Main Street                |
| Grand Rapids 2, Mich. . . . .  | 148 Monroe Avenue, Northwest    | Syracuse 1, N. Y. . . . .        | 113 South Salina Street         |
| Hartford 3, Conn. . . . .      | 410 Asylum Street               | Tacoma 1, Wash. . . . .          | 1019 Pacific Avenue             |
| Houston 1, Texas . . . . .     | 1312 Live Oak Street            | Tampa 6, Fla. . . . .            | 1206 North A Street             |
| Indianapolis 4, Ind. . . . .   | 110 North Illinois Street       | Toledo 4, Ohio . . . . .         | 420 Madison Avenue              |
| Jackson, Mich. . . . .         | 212 Michigan Avenue, West       | Tulsa 3, Okla. . . . .           | 409 South Boston Street         |
| Jacksonville 2, Fla. . . . .   | 237 West Forsyth Street         | Utica 2, N. Y. . . . .           | 258 Genesee Street              |
| Kansas City 6, Mo. . . . .     | 106 West Fourteenth Street      | Washington 5, D. C. . . . .      | 806 Fifteenth Street, Northwest |
| Knoxville 08, Tenn. . . . .    | 602 South Gay Street            | Waterbury 32, Conn. . . . .      | 111 West Main Street            |
| Los Angeles 54, Calif. . . . . | 212 North Vignes Street         | Wichita 2, Kan. . . . .          | 102 South Broadway              |
| Louisville 2, Ky. . . . .      | 455 South Fourth Street         | Worcester 8, Mass. . . . .       | 165 Commercial Street           |
| Louisville 2, Ky. . . . .      | 8 North Third Street            | Youngstown 3, Ohio . . . . .     | 25 East Boardman Street         |
| Memphis 3, Tenn. . . . .       | 25 Southeast Second Street      |                                  |                                 |
| Miami 32, Fla. . . . .         |                                 |                                  |                                 |

Canada: Canadian General Electric Company, Ltd., Toronto  
G-E products can also be obtained through Agents and Distributors located in principal cities and towns

Hawaii: W. A. Ramsay, Ltd., Honolulu

③

